



# WATER AND SEWER LINE COEXISTING TRENCH DETAIL

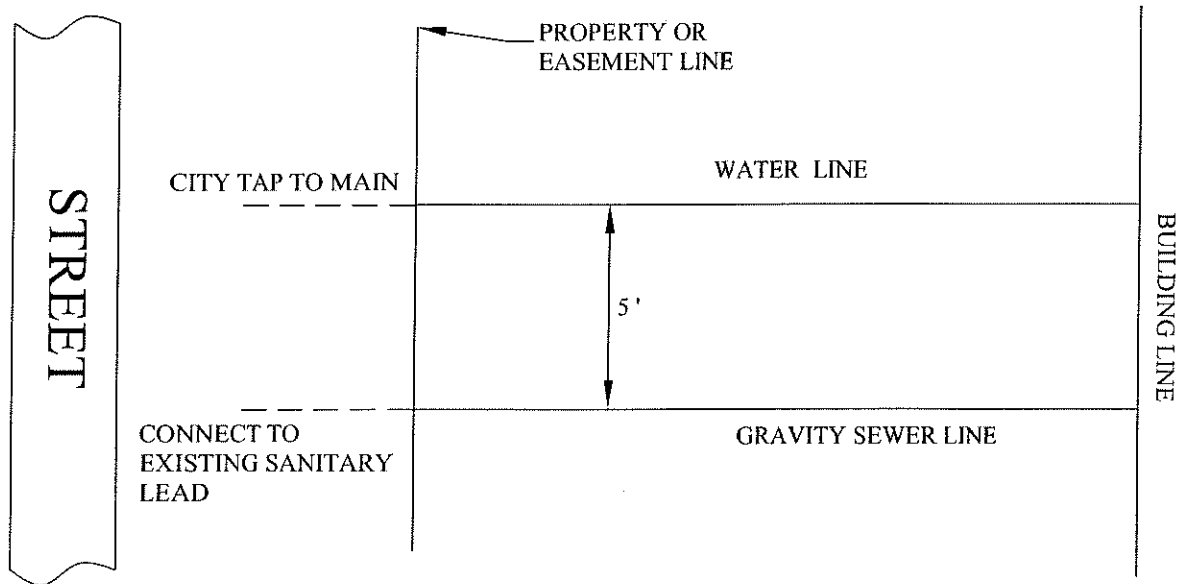

PLAN VIEW

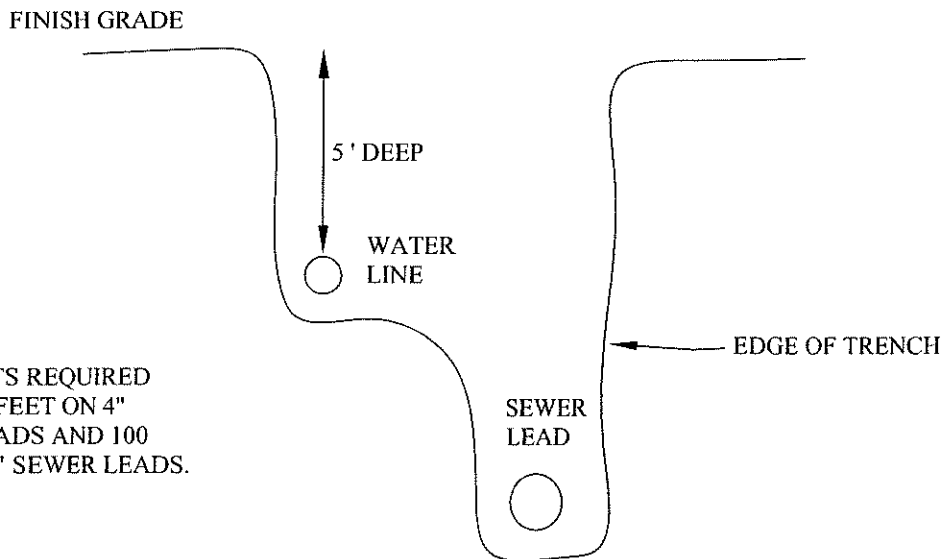

NOTE: CLEANOUTS REQUIRED EVERY 50 FEET ON 4" SEWER LEADS AND 100 FEET ON 6" SEWER LEADS.

PROFILE VIEW



**City of Rochester Hills**

1000 Rochester Hills Drive

Rochester Hills, Michigan 48309

NOTIFY ROCHESTER HILLS  
ENGINEERING SERVICES @  
248-841-2510 48 HRS. PRIOR  
TO START OF  
CONSTRUCTION

NOT TO SCALE

DATE: 3/27/2008

SHEET 1 OF 1