
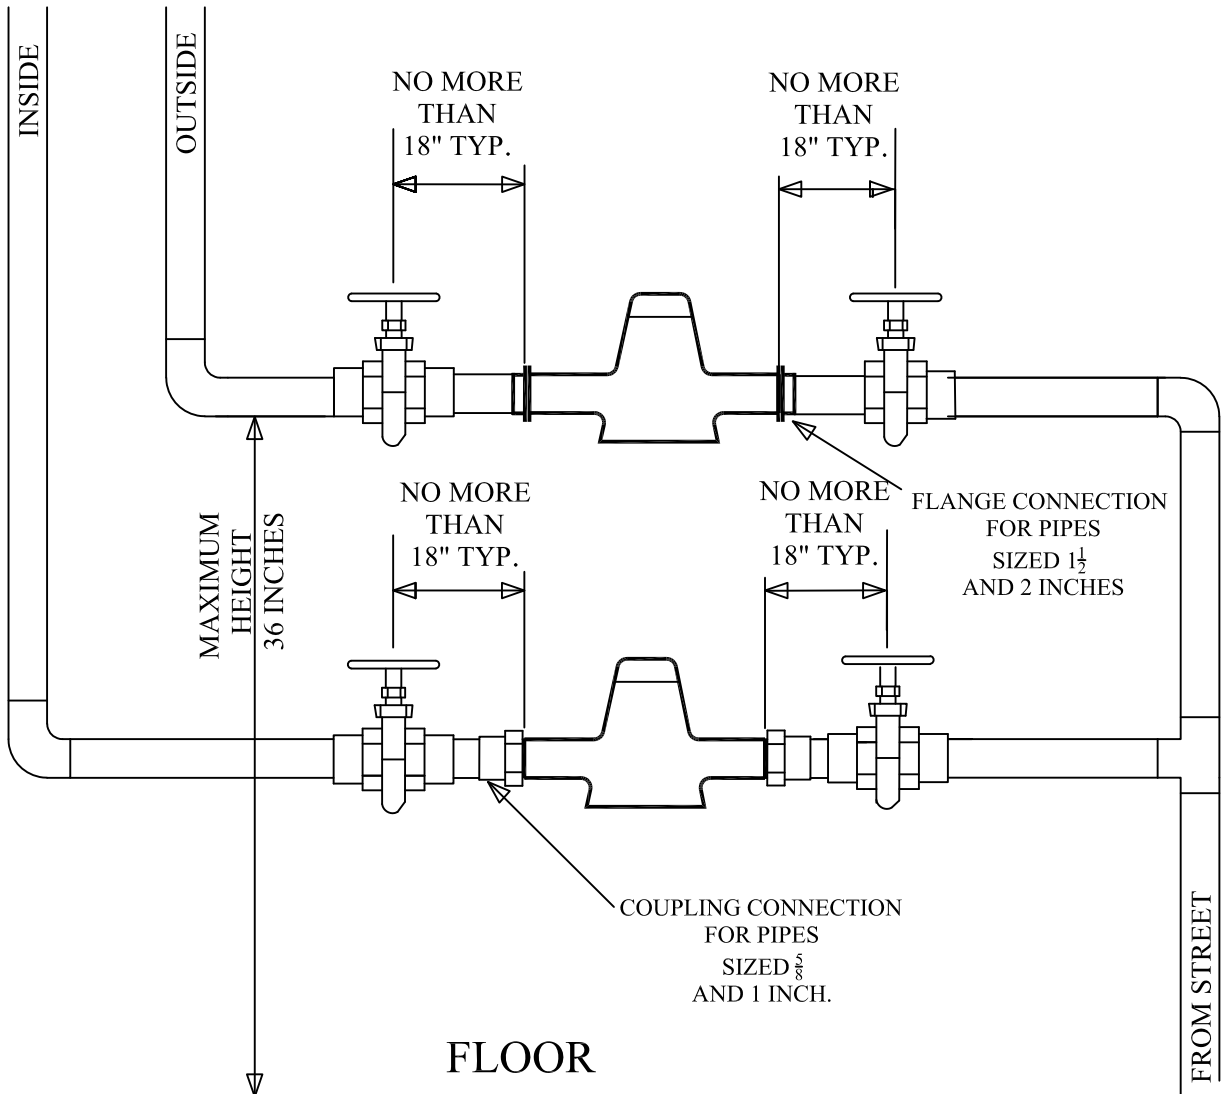


# COMMERCIAL AREA MAINTENANCE METER OUTSIDE USE ONLY

**NOTES:**

- METERS MUST BE PLUMBED HORIZONTALLY AND BE SET IN AN ACCESSIBLE LOCATION
- WITH EXCEPTION OF THE INCOMING WATER LINE ALL PLUMBING MUST BE HARD COPPER/BRASS OR DUCTILE ALL THE WAY TO THE SECOND VALVE ON THE WATER METERS.
- NO SPIGOTS ARE ALLOWED INSIDE BUILDING AFTER AM METER. ONLY BLEED SCREW TYPE DRAINS ARE ALLOWED. SEE EXAMPLE.
- NO PEX OR SHARK BITES ARE ALLOWED PRIOR TO THE SECOND VALVE.
- COMPRESSION FITTINGS WITH SPLIT RING LOCKING DEVICE MUST BE USED FOR ALL SPLICES AND TRANSITIONS ON THE WATER SERVICE LINE.

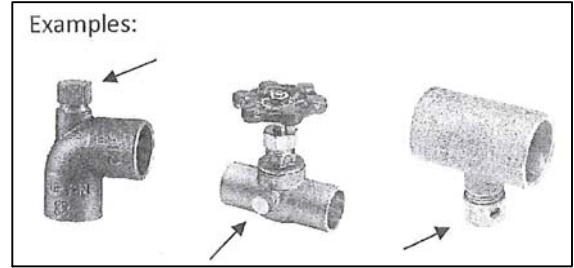

FILE LOCATION: I:\Eng\DWG\DETAILS\WATER\area maintenance\Area Maintenance Meter Commercial.pdf	
REV.	DRAWN BY
2018-07-25 - SW	JRB
2019-03-13 - SW	DATE
2021-04-05 - SW	06-27-17

**CITY OF ROCHESTER HILLS**  
*Department of Public Services*  
1000 ROCHESTER HILLS DRIVE  
ROCHESTER HILLS, MICHIGAN 48309  
PHONE : (248) 656-4640

DRAWING NO.  
1 OF 1

