


WATER SERVICE LINE CONNECTION

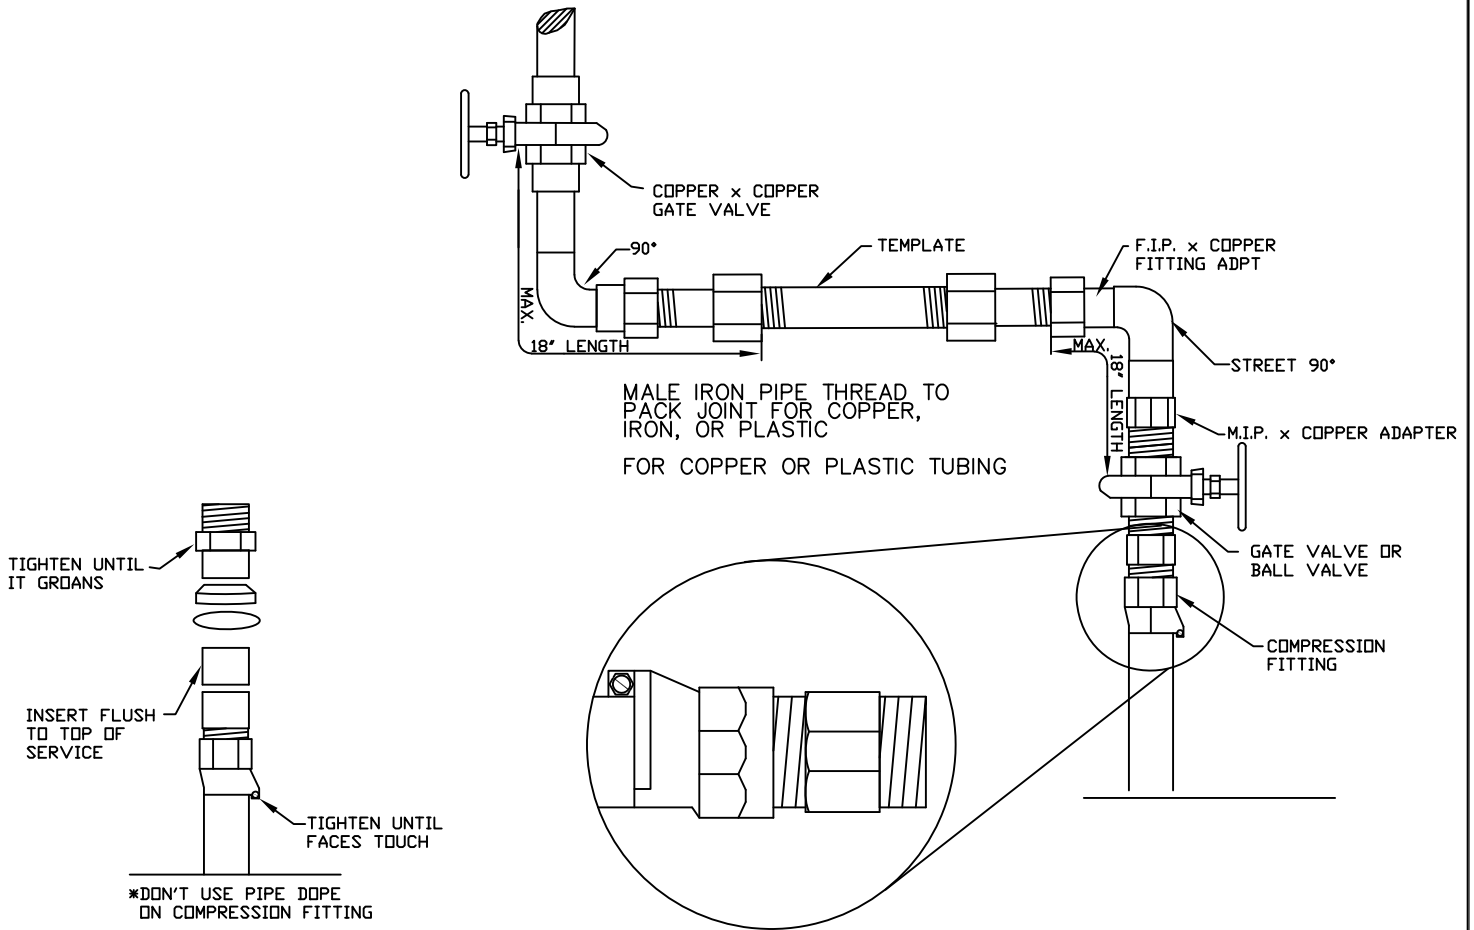

NOTES:

- COMPRESSION FITTINGS WITH SPLIT RING LOCKING DEVICE MUST BE USED FOR ALL SPLICES AND TRANSITIONS ON SERVICE LINE.
- WITH EXCEPTION OF THE INCOMING WATER LINE ALL PLUMBING MUST BE HARD COPPER/BRASS OR DUCTILE ALL THE WAY TO THE SECOND VALVE ON THE WATER METERS.
- NO BARB FITTINGS
- NO HOSE CLAMPS
- NO PEX OR SHARK BITES ARE ALLOWED PRIOR TO THE SECOND VALVE.
- SHUT OFF VALVES CANNOT BE MORE THAN 18' AWAY FROM THE ENDS OF TEMPLATE/METER.

file location: I:\ENG\DWG\DETAILS\WATER\WTR_HKUP.PDF	
rev.	drawn by
2019-03-13 - SW	JRB
2019-12-02 - SW	
2021-04-05 - SW	date
	1/16/18

CITY OF ROCHESTER HILLS
Department of Public Services
 1000 ROCHESTER HILLS DRIVE
 ROCHESTER HILLS, MICHIGAN 48309
 PHONE : (248) 656-4640

drawing no.	
1 of 1	